


Crowcon FGard SIM

Flame Detector – Flame Simulator

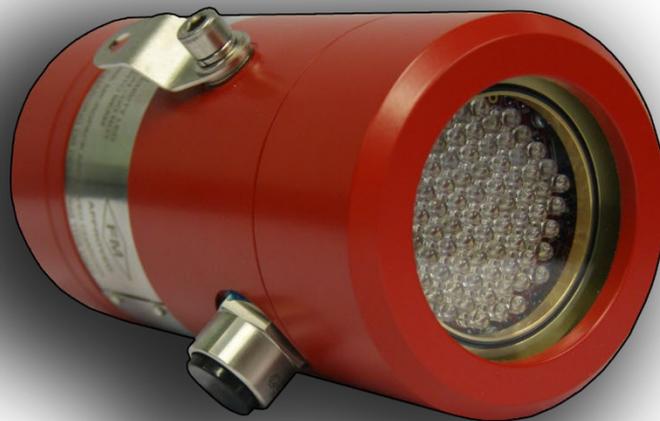

Operating Instructions

Flame simulator (FGard SIM) – FD-AC-08

Issue 1: February 21

Contents

1	Introduction	4
1.1	Features	4
1.2	Flame Simulator Enclosure.....	4
2	Safety Instructions	5
2.1	Warnings.....	5
2.2	Cautions.....	5
2.3	Important Notices.....	5
3	Operating Instructions	6
4	Maintenance and Testing	7
4.1	Routine.....	7
4.2	Battery Charging	7
5	Fault Finding	7
5.1	Diagnostics	7
6	Replacement or Repair	8
7	Technical Specification	9
7.1	Electrical Specification – Battery Pack.....	9
7.2	Technical Specification – Charger	9
7.3	Mechanical Specification	9
7.4	Environmental Specification.....	9
7.5	Certification and Approvals	10
7.6	Flame Simulator Ordering Information.....	10
8	Appendix A - Help us to help you.....	11

1 Introduction

The Crowcon FGard SIM Flame Simulator is used to test the correct operation of the Crowcon FGard IR3 flame detector.

The simulator has been designed specifically to enable long range testing of the FGard IR3 flame detectors only. The device has been designed for handheld use by a single operator. The device is a completely self-contained, portable unit. A single charge is sufficient to test up to fifty flame detectors.


The simulator has been designed specifically for use in the extreme marine environments experienced offshore.

1.1 Features

- Long Range – the flame simulator can reliably operate FGard IR3 flame detectors at 3m to 8m.
- Portable – the flame simulator is a portable handheld unit designed for single operator operation.
- Robust and Reliable – the flame simulator has been designed for extreme offshore conditions.
- Reduced Maintenance Costs – reduces the need for scaffold or ladder access to the detector.

1.2 Flame Simulator Enclosure

The flame simulator electronics are housed in an enclosure which is certified for use in hazardous areas. For the exact certification and conditions of use see certification label on the device, or the example drawing below:

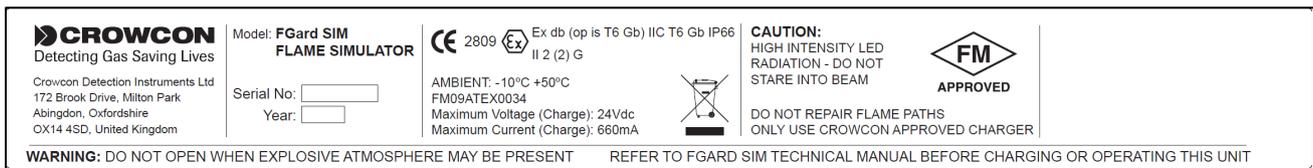

Note – certification banding will change.

The enclosure comprises of two enclosure covers (one with a faceplate window), the enclosure body (with certification label) and fixing collars to connect the enclosure body and covers together.

2 Safety Instructions

For the correct and effective use of this equipment, to maintain safety and avoid hazards it is essential that you read and understand these instructions fully and act accordingly BEFORE operating this equipment.

PAY ATTENTION TO ALL SAFETY WARNINGS AND CAUTIONS

2.1 Warnings

- This equipment is certified and intended for use in potentially hazardous areas.
- For installations in North America the National Electrical Code (NEC) should be strictly observed.
- Where appropriate local or national regulations should be used.
- The enclosure lid and body should always be fully tightened and locked into position before energising the equipment.
- Do not open the enclosure in the presence of a flammable atmosphere.
- All permits and proper site procedures and practices must be followed.
- Repair of equipment should never be performed by non-trained personnel.

2.2 Cautions

- Use only approved parts and accessories with this equipment.
- Do not attempt to replace the window as the glass and the front cover are individually matched pairs to meet the stringent requirement of the Hazardous area certification.
- The threaded portions of the detector are flame paths. These threads and the flame paths around the window are not to be repaired.
- To maintain safety standards, regular maintenance should be performed by qualified personnel.
- Charge flame simulator only; do not charge primary cells, lithium, or lead acid batteries - risk of explosion and chemical danger.
- Do not charge batteries with too high charge current.
- Disconnect charger from the mains and battery pack if it is not used for a long time.
- Do not charge hot batteries. Batteries must be at ambient temperature before charging.
- Stop the charging process if the battery gets too hot during charging ($>55-60^{\circ}\text{C}$).
- Do not charge the batteries twice. Charging is only allowed after prior discharge.
- Do not expose the battery charger to rain, damp, or hot conditions. Charger is for indoor use only.
- Do not leave the charger unattended during operation.
- Do not plug in the charger if there are signs of damage to the housing, cables, connectors, or mains plug.
- Do not open equipment or carry out repairs. Authorized personnel may only carry out repairs.
- Do not cover equipment or obstruct ventilation, otherwise it may over-heat. Do not expose to direct sunlight.
- Keep flame simulator, battery charger and cables away from combustible materials.

2.3 Important Notices

- Pay attention to the guidelines given throughout this document.
- If in any doubt, ask your local sales representative or contact Crowcon.
- Crowcon takes no responsibility for use of its equipment if this is not in accordance with the appropriate issue and/or amendment of the manual.
- Crowcon reserve the right to change or revise the information contained herein.

4 Maintenance and Testing

4.1 Routine

There is no set maintenance routine for the flame simulator due to the simplicity of the device. All internal maintenance or repair must be conducted by Crowcon.

Therefore, routine maintenance is simply limited to ensuring the faceplate window is kept clean and that no damage to the integrity of the enclosure or flame paths is caused.

4.2 Battery Charging

A charging unit is supplied with the flame simulator. Simply remove the reverse cover to reveal the charging socket, and conduct the following:

- Connect plug to flame simulator.
- Connect the power plug into a convenient mains socket (adaptors supplied for various world locations).
- After connecting the charger with the Flame Simulator, charging starts automatically.
- For charging indicators, please see charging table below:

Parameter	Comment
Charging Indicators	No battery: LED off. Charging: LED blinking green. Charge end: LED lights green. Error: LED blinking red.

- The charging process is done according to the dV technology.
- After charge end the charger goes in trickle charge mode automatically.
- To stop charging, disconnect the charger from the mains supply at any time before removing the plug from the simulator.

Note: battery charging should never take place within a hazardous area.

5 Fault Finding

5.1 Diagnostics

Fault finding by personnel other than Crowcon employees is prohibited and non-compliance of this will invalidate the warranty. If the flame simulator fails to operate there are two simple causes:

- a) The flame simulator batteries need recharged, or
- b) The unit is faulty and needs to be returned to Crowcon.

6 Replacement or Repair

The flame simulator contains no user serviceable parts.



In the unlikely event of a fault with the FGard SIM Flame Simulator please contact Crowcon (sales@crowcon.com). Please ensure that the flame simulator and flame detector are being used correctly in the first instance by referring to their manuals.

Detector/simulator returns along with a written statement describing any fault should be sent to the address listed below:

Crowcon Detection Instruments Ltd.

172 Brook Drive,

Milton Park,

Abingdon,

Oxfordshire,

OX14 4SD,

United Kingdom.

7 Technical Specification

7.1 Electrical Specification – Battery Pack

Parameter	Units	Max	Comment
4 Cells	Vdc	1.2	Each battery cell
Current	A	2.6	
Capacity	A-h	1.8	
Fast charge	Hours	1	
Full discharge / charge	Hours	10	

7.2 Technical Specification – Charger

Parameter	Units	Max	Comment
Input Voltage	Vac	100-240	+/- 10%
Charge Method			-dV
Max. Charge Current	mA	800	+/- 10%
Frequency	Hz	50-60	
Case Protection	IP	20	
Charging Indicators	No battery: LED off Charging: LED blinking green Charge end: LED lights green Error: LED blinking red		
Dimensions L x W x H	mm	118 x 62 x 47	(without mains plug)

7.3 Mechanical Specification

Parameter	Units	Value	Comment
Enclosure			
Overall Dimensions	mm	100 Diameter x 200 Length	
Shipping Weight	Kg	2.5	
Material		HE30 Aluminium	
Coating	Colour	Red Epoxy Coated Finish	
Push button	mm	1 x M25	
Ingress Protection	IP	66	
Transit Case			
Overall Dimensions	mm	410L x 200H x 175W	
Shipping Weight	Kg	4.5	

7.4 Environmental Specification

Parameter	Units	Min	Min	Comment
Operating Ambient Temperature	°C	-10	+50	
Storage Ambient Temperature	°C	0	+45	
Relative Humidity	%RH	0	100	Non-condensing

7.5 Certification and Approvals

Parameter	Authority/ Standard	Approval	Certificate*
Hazardous Area Certification	ATEX - EN 60079-1:2014	Ex II 2 (2) G Ex db (op is T6 Gb) IIC T6 Gb IP66	FM09ATEX0034
Explosive Atmospheres	ATEX - EN 60079-28:2007	Ex II 2 (2) G Ex db (op is T6 Gb) IIC T6 Gb IP66	FM09ATEX0034

Note - Certificate numbers are subject to change.

7.6 Flame Simulator Ordering Information

Parameter	Part Number
Crowcon flame detector - Flame simulator (FGard SIM)	FD-AC-06

8 Appendix A - Help us to help you.

<p>TO: QA Department</p> <p>Crowcon Detection Instruments Ltd. 172 Brook Drive, Milton Park, Abingdon, Oxfordshire, OX14 4SD, United Kingdom.</p> <p>sales@crowcon.com</p>	<p>From:</p> <p>Tel:</p> <p>Fax:</p> <p>Email:</p>
<p>I suggest the following corrections/changes be made to Section</p>	
<p>Marked up copies attached (as appropriate): Yes/No</p>	
<p>Please inform me of the outcome of this change: Yes/No</p>	
<p>For Crowcon</p> <p>Action by: _____</p> <p>Date: _____</p> <p>Response: _____</p> <p>Date: _____</p>	



A **Halma** company



UK Office

Crowcon Detection Instruments Ltd
172 Brook Drive,
Milton Park,
Abingdon
Oxfordshire
OX14 4SD
Tel: +44 (0) 1235 557700
Fax: +44 (0) 1235 557749
Email: sales@crowcon.com
Website: www.crowcon.com

USA Office

Crowcon Detection Instruments Ltd
1455 Jamike Ave, Suite 100
Erlanger
KY 41018
Tel: +1 859 957 1039 or 1 800 527
6926
Fax: +1 859 957 1044
Email: salesusa@crowcon.com
Website: www.crowcon.com

Netherlands Office

Crowcon Detection Instruments Ltd
Vlambloem 129
3068JG, Rotterdam
Netherlands
Tel: + 31 10 421 1232
Fax: + 31 10 421 0542
Email: eu@crowcon.com
Website: www.crowcon.com

Singapore Office

Crowcon Detection Instruments Ltd
Block 194, Pandan Loop
#06-20 Pantech Industrial Complex
Singapore 128383
Tel: + 65 6745 2936
Fax: +65 6745 0467
Email: sales@crowcon.com.sg
Website: www.crowcon.com

China Office

Crowcon Detection Instruments Ltd
(Beijing)
Unit 316, Area 1, Tower B, Chuangxin
Building
12 Hongda North Road, Beijing Eco-
nomic Technological Development Area
Beijing, China 100176
Tel: +86 10 6787 0335
Fax: +86 10 6787 4879
Email: saleschina@crowcon.cn
Website: www.crowcon.com