Notes:
1. XgardIQ
2. Sil 2
3. Atex Ex II 2 G
4. 14-30 VDC. <4W
5. 316 stainless steel

Bill of Material	
Description	Qty
XgardIQ Transmitter	1
XgardIQ Sensor	1

Weight	4.1kg

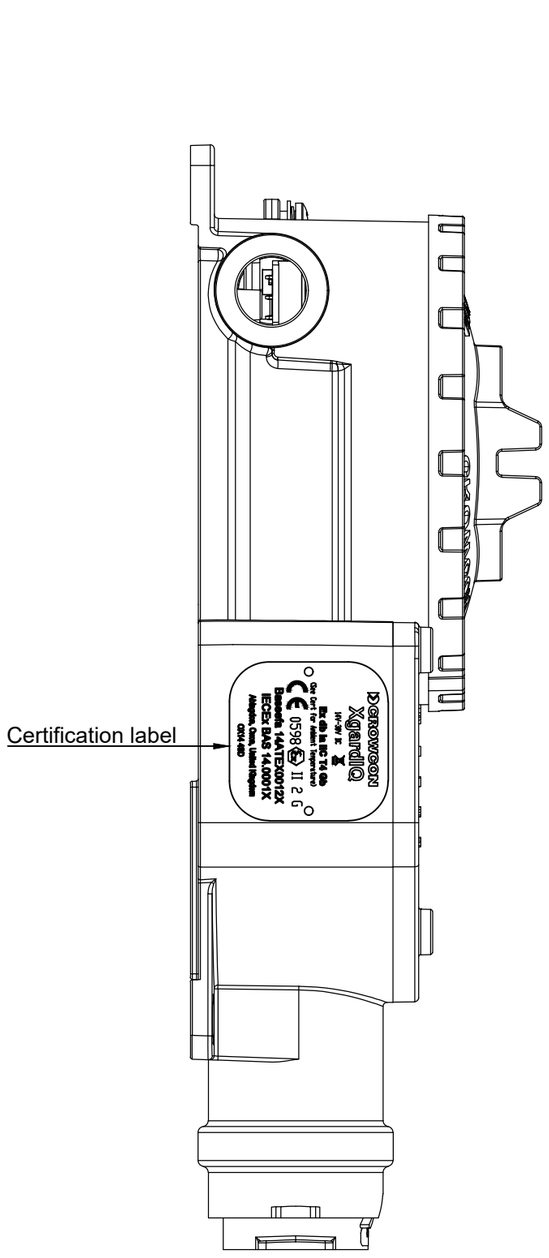

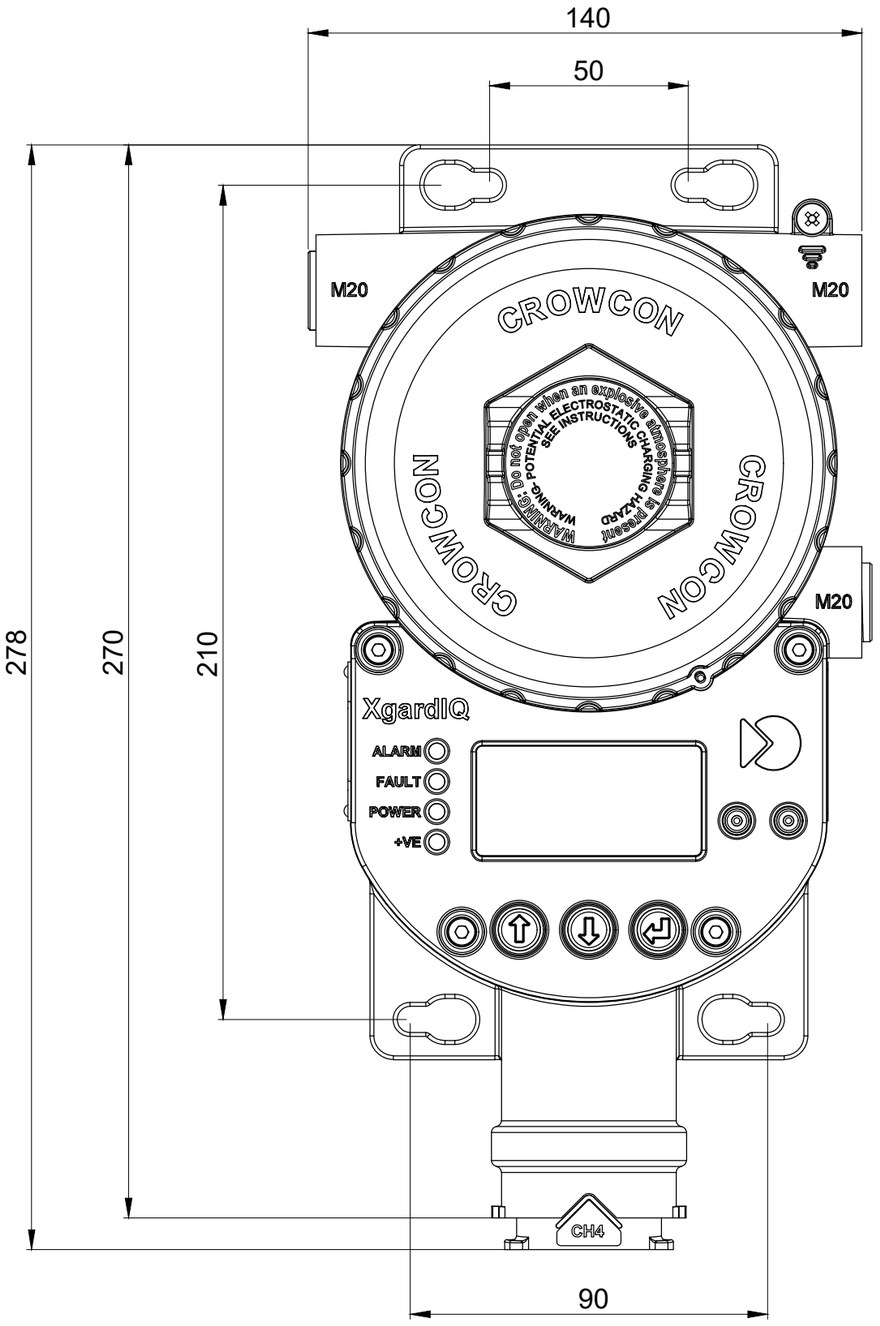

Certification label

CROWCON
XgardIQ
14V-30V DC
Ex db ia IIC T4 Gb
(See Cert for Ambient Temperature)
CE 0598 Ex II 2 G
Baseefa 14ATEX0012X
IECEx BAS 14.0001X
Abingdon, Oxon, United Kingdom
OX14 4SD

XgardIQ Transmitter

Instrument label Product code and serial number

CROWCON
XgardIQ
Product Code XIQ-ZZ-S1-011-Z-R-A
GAS TYPE SEE SENSOR
w326991/01-028
120

Product Code

Serial Number

XgardIQ Sensor Module

ISSUE	CHANGE No.	DATE	ISSUE	CHANGE No.	DATE	ISSUE	CHANGE No.	DATE
A0		10-09-24						

DO NOT SCALE IF IN DOUBT ASK

3rd Angle Projection

CROWCON
172 Brook Drive, Milton Park Business Park, Abingdon, Oxfordshire OX14 4SD

This drawing is the property of CROWCON Detection Instruments Ltd and must not be loaned, copied in whole or in part or used for manufacturing or tendering purposes without their consent. Copyright Reserved.

END USER			CUSTOMER
DRN	BUILT BY	APPR	PROJECT
CB			

TITLE: XGARDIQ GENERAL ARRANGEMENT DRAWING

ORIGINAL SCALE	DRG. No.	ISS.
NTS	XGARDIQ-01	A0